

Digital I/O Module v2 User Manual

Contents

[Overview](#)

[Features](#)

[Included in the Box](#)

[Physical Interface](#)

[Status LED Indicators](#)

[Resetting the electronic fuse](#)

[Applications](#)

[Connecting to MachineMotion 2 \(directly\)](#)

[Connecting to MachineMotion 2 \(daisy chain\)](#)

[Connecting non-Vention components as digital inputs/outputs](#)

[Setting the address configuration switches](#)

[Configuring the Digital I/O Module v2 in Control Center](#)

[Programming the Digital I/O Module v2 with MachineLogic](#)

[Using the Digital I/O Module v2 with the Python API](#)



Overview

The Digital I/O Module v2, CE-MD-001-0000__2, extends MachineMotion 2's functionality with 4 (NPN or PNP) inputs and 4 PNP outputs. This plug-and-play module only requires a single connection to the MachineMotion 2 controller. Compatible modules, such as the Power Switch (CE-MD-005-0000) & additional Digital I/O Module v2 modules can also be daisy chained to each other, making it possible to connect up to eight modules per MachineMotion 2 controller.

Features

- 4 Inputs compatible with NPN and PNP sensors
- Connects (daisy chain) with compatible modules
- Configurable address
- Plug-and-play access from the Control Center, MachineLogic, and Python API

Included in the Box

Part Number	Description	Quantity
CE-MD-001-0000__2	Digital I/O Module v2	1

Part Number	Description	Quantity
CE-CA-022-5000	Control Device Extension Cable, 5m	1
CE-JP-001-0001	Module Termination Jumper	1
HW-FN-003-0018	M8 x 18-mm Screw	2
HW-FN-002-0001	M8 Drop-in Spring-Loaded T-Nut	2

Physical Interface

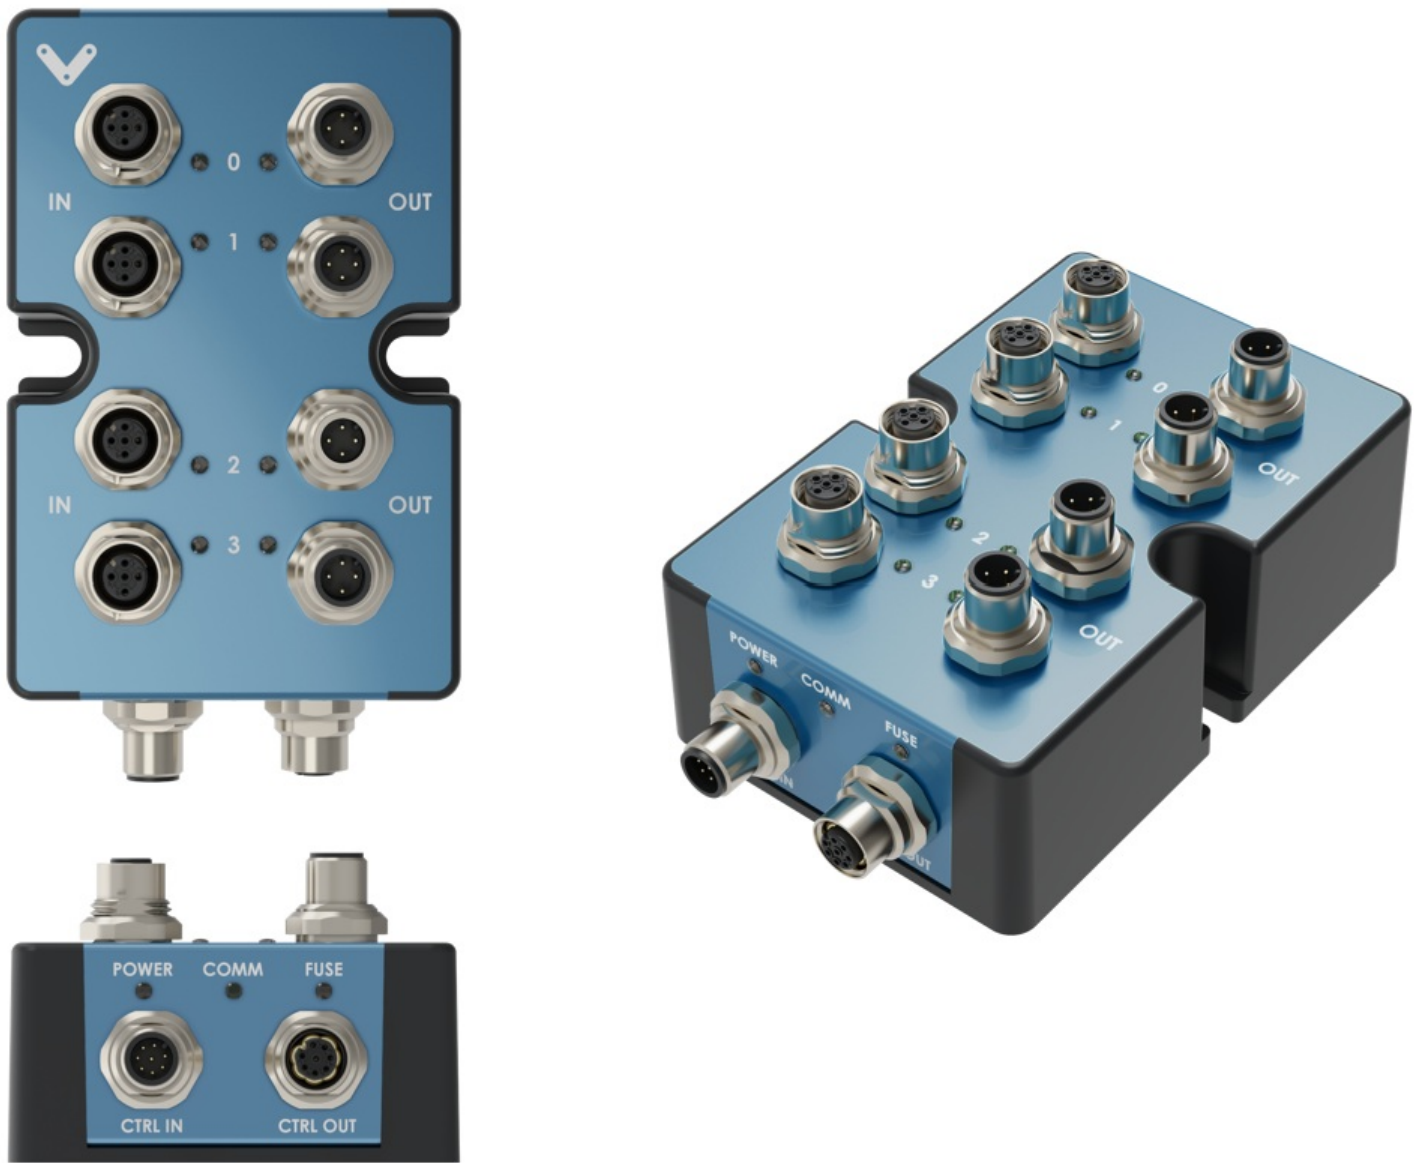


Figure 1 - Digital I/O Module v2 Physical Interface

Status LED Indicators

Name	LED Color	Indicated (when ON)
POWER	White	24 VDC supplied to module

Name	LED Color	Indicated (when ON)
COMM	Yellow and Blue	RS-485 communication functional
FUSE	Red	Module internal fuse tripped
STATUS LED - OUT	White	Active (24V)
STATUS LED - IN	White	Active (24V or 0V)

Resetting the electronic fuse

The Digital I/O Module v2 has an internal resettable electronic fuse that will trip in case of a short-circuit between the power pins (24V and 0V). This may occur when connecting a faulty or miswired device to the module, or even by touching pin #1 and pin #3 of any digital input/output port with a metallic object. If the fuse trips on a given module, **the FUSE status LED will turn on red**, but modules connected on the same daisychain will not be affected since each of them has its own fuse. **To reset the fuse, simply disconnect and reconnect the cable on the CTRL IN port.**

Applications

Connecting to MachineMotion 2 (directly)



Figure 2 - Connecting Digital I/O v2 directly to MachineMotion 2

To connect a Digital I/O Module v2 directly to MachineMotion 2 (see Figure 2):

1. Set the address of the Digital I/O Module v2, as explained in the Setting the address configuration switches section below.
2. Using the Control Device Extension Cable (CE-CA-022-5000):
 1. Connect the male end to any CONTROL port on MachineMotion 2.
 2. Connect the female end to the CTRL IN port on the Digital I/O Module v2.
3. Connect the Module Termination Jumper (CE-JP-001-0001), to the CTRL OUT port on the Digital I/O Module v2.

Connecting to MachineMotion 2 (daisy chain)

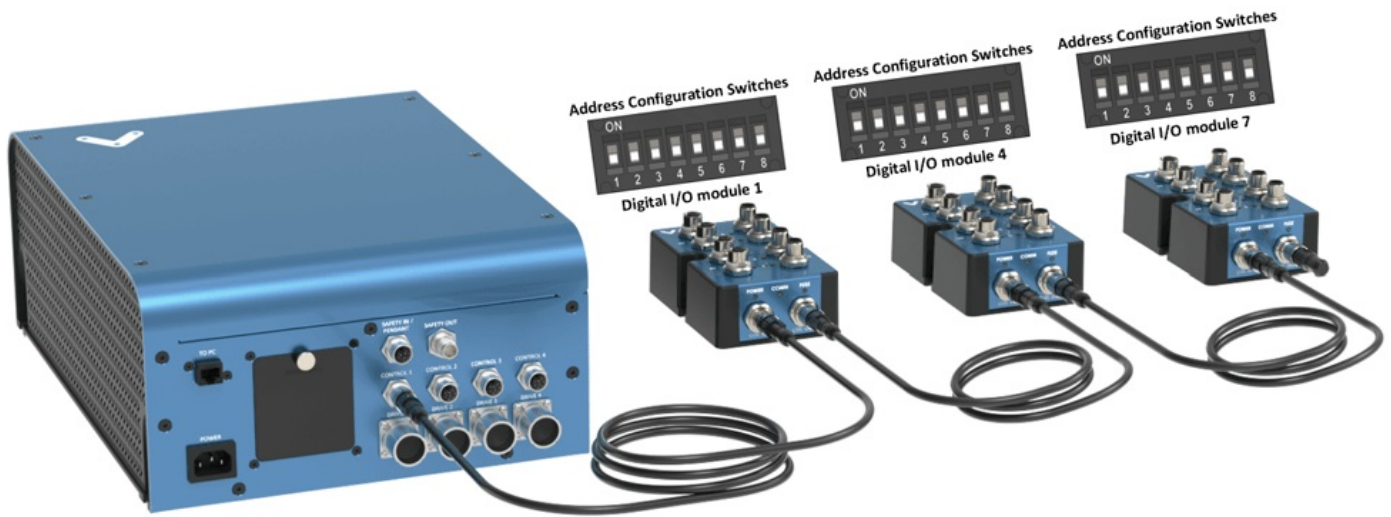


Figure 3 - Connecting Digital I/O v2 via Daisy Chain to MachineMotion 2

Compatible modules, including the Digital I/O Module v2 can also be connected via daisy chain to a single CONTROL port on the MachineMotion 2 controller (see Figure 3). Across all four CONTROL ports, the controller supports up to eight modules at the same time, provided they all have distinct addresses (see Address configuration switches).

To connect several modules in a daisy chain:

1. Set a distinct address for every module of the daisy chain, as explained in the section Setting the address configuration switches.
2. Using a Control Device Extension Cable (CE-CA-022-5000):
 1. Connect the male end to any CONTROL port on MachineMotion 2.
 2. Connect the female end to the CTRL IN port on the first module of the daisy chain.
3. For every additional module to be connected in the daisy chain, repeat this step using an additional Control Device Extension Cable (CE-CA-022-5000):
 1. Connect the male end to the CTRL OUT port on the previous module in the daisy chain.
 2. Connect the female end to the CTRL IN port on the current module in the daisy chain.
4. Connect the Module Termination Jumper (CE-JP-001-0001), to the CTRL OUT port on the last module in the daisy chain.

Connecting non-Vention components as digital inputs/outputs

While every Vention component (sensors, pneumatic manifolds, etc.) is compatible with the Digital I/O Module v2 out-of-the-box, other external devices can also be easily connected to the module.

To connect a non-Vention device as a **digital input** (e.g. sensors, switches, etc.):

1. The signal can be either NPN (sinking, active 0V) or PNP (sourcing, active 24V).
2. If the device uses a M12, 4-pin, A-keyed, male interface with the signal on pin #2, you can connect it directly to any module input.
3. If the device does not use such interface or if the signal is on a different pin, use **field-wireable male connector adapter CE-CN-030-0001** with the pinout shown below.

Digital Input Pin	Description
Pin 1	24 VDC
Pin 2	Input
Pin 3	Ground
Pin 4	Not Connected

To connect a non-Vention device as a **digital output** (e.g. valve, relay, LED, etc.):

1. The activating signal has to be PNP, operate at 24V and consume no more than 100mA.
2. If the device uses a M12, 4-pin, A-keyed, female interface with the signal on pin #2, you can connect it directly to any module output.

- If the device does not use such interface or if the signal is on a different pin, use **field-wireable female connector adapter CE-CN-048-0002** with the pinout shown below.

Digital Output Pin	Description
Pin 1	24 VDC
Pin 2	Output
Pin 3	Ground
Pin 4	Not Connected

Setting the address configuration switches

Each module has an address with two components: device ID and device type. Both device ID and device type are set by changing the state of the address configuration switches, which are located at the back of the Digital I/O Module v2 under a removable rubber cap.

Switches 1 to 4 define the module device ID and allow the MachineMotion 2 controller to know which module it is communicating with. Every module connected to the same controller should have a **distinct device ID, regardless of its device type**.

Switches 5 to 8 define the module device type and their positions should remain identical for all modules of the same type.

The table below lists every valid address for the Digital I/O Module v2. An individual switch is considered ON when the selector is slid up and OFF when the selector is slid down.

Switches								Module Address
Device ID				Device Type				
1	2	3	4	5	6	7	8	
OFF	OFF	OFF	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 1
ON	OFF	OFF	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 2
OFF	ON	OFF	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 3
ON	ON	OFF	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 4
OFF	OFF	ON	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 5
ON	OFF	ON	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 6
OFF	ON	ON	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 7
ON	ON	ON	OFF	OFF	OFF	OFF	OFF	Digital I/O Module 8

Table 1: Digital I/O module v2 configurable addresses.

Configuring the Digital I/O Module v2 in Control Center

If you would like to configure your Digital I/O module v2 and utilize MachineLogic to program your Digital I/O module, v2 follow the steps below:

- Open the Control Center on a PC (by entering 192.168.7.2 in the Google Chrome URL) or use the MachineMotion 2 Pendant.
- Go to the **Configuration** tab and click **Add Input**.
- Fill out the following fields:
 - Name:** Give your Digital I/O module v2 a friendly name, which will be used to call the Digital I/O module v2 in MachineLogic
 - Module Type:** In the drop-down menu, select **Digital IO**
 - Device:** Represents the device ID of your module. The device number is configured on the physical module using dip-switches, therefore, ensure the device ID configured in this dropdown matches the dip switches configured on the physical device.
 - Pin:** Select the pin that you would like to control.

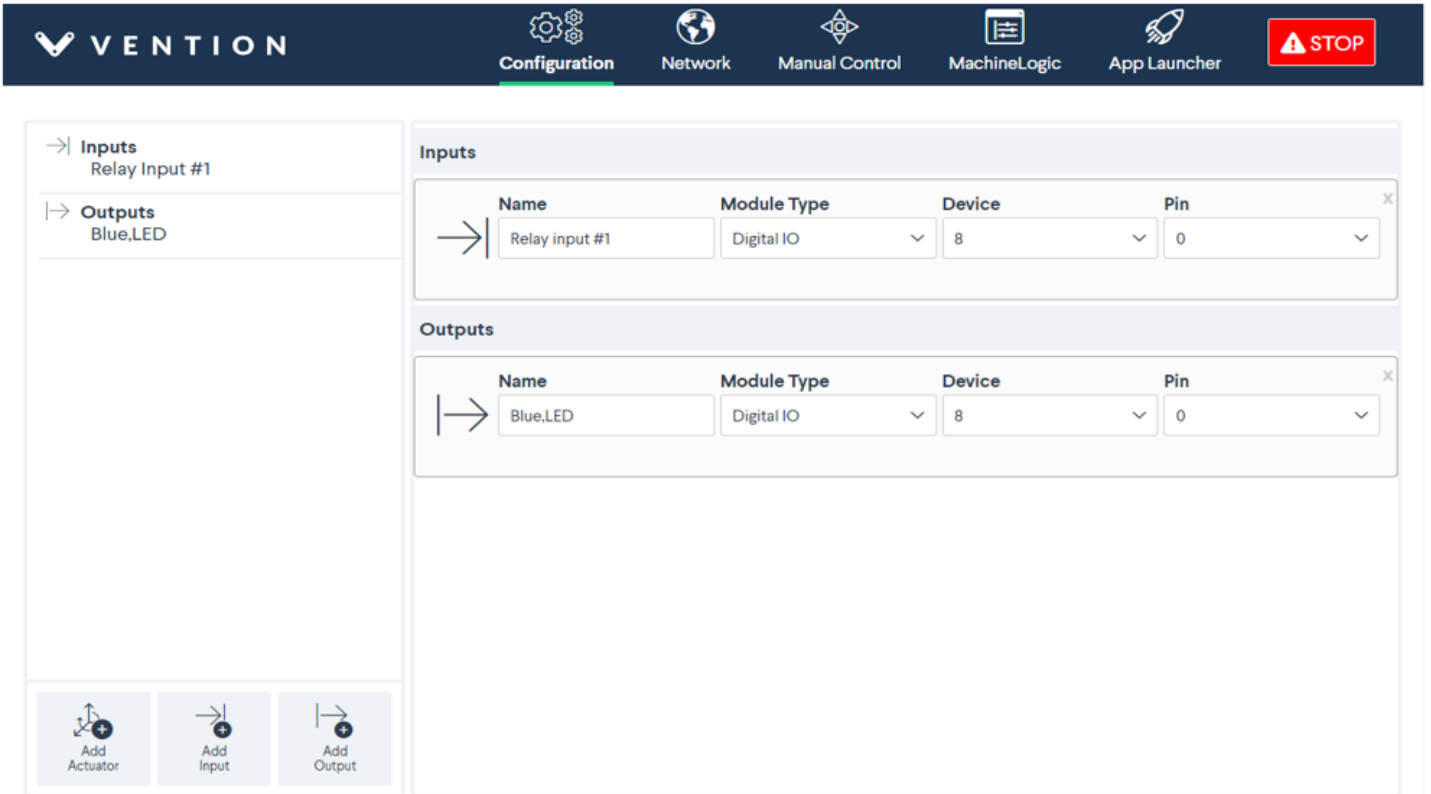


Figure 4: Digital I/O module v2 configuration

1. To test the configured Digital I/O, go to the **Manual Control** tab and navigate to the **Digital Inputs/Outputs** at the bottom left of the screen.
2. Under **Inputs**, you should see your configured Digital I/O modules v2:

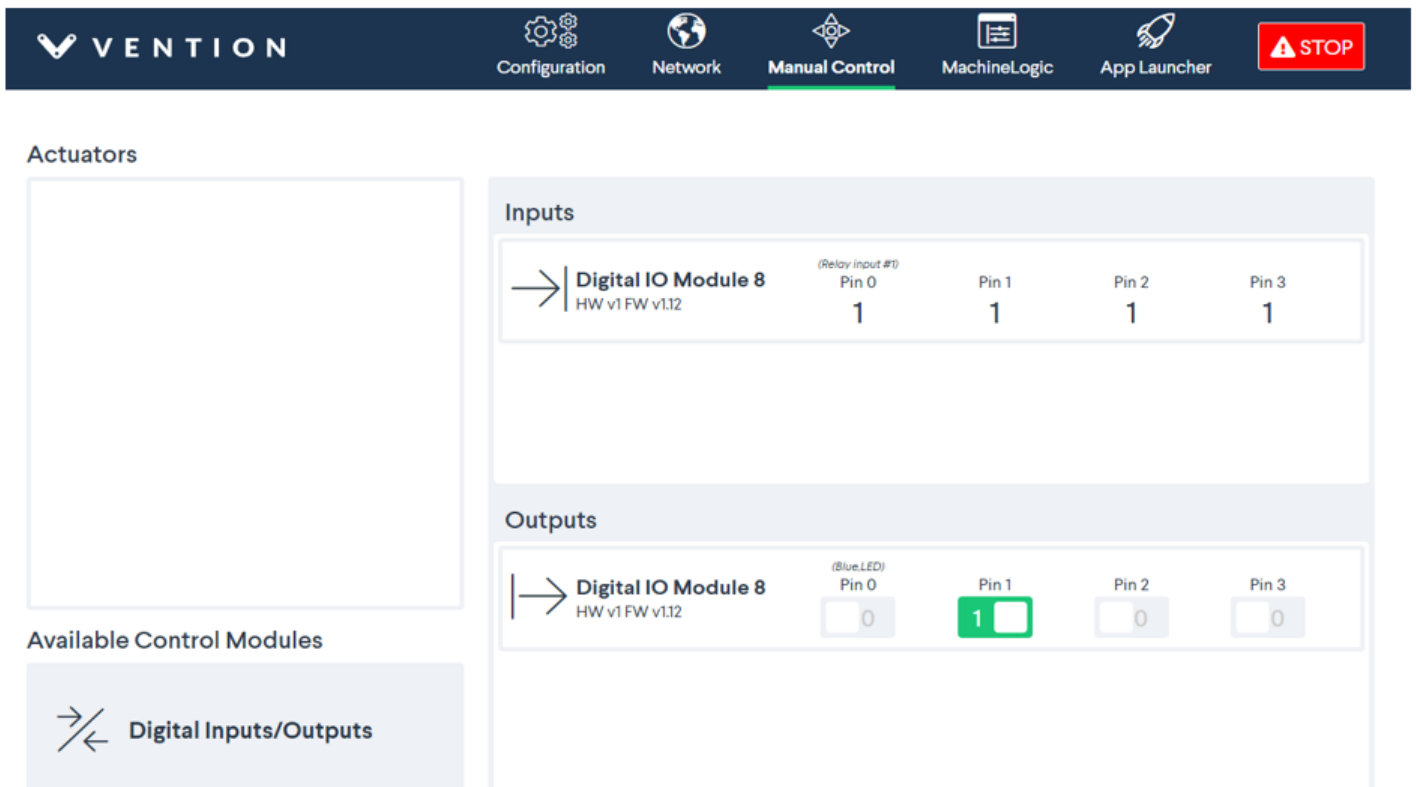


Figure 5: Digital I/O module v2 manual control

Programming the Digital I/O Module v2 with MachineLogic

To program your Digital I/O module v2 in MachineLogic, ensure you have completed the steps in [Configuring the Digital I/O Module v2 in Control Center](#).

1. Go to the **MachineLogic** tab.
2. Click **Add command > Add Output**:
 1. Under **Output**, selecting **Digital Output**
 2. Under **Output Name** select your device
 3. Under **Value**, select the state that you would like your device to be in
3. Click **Add command > Add Wait**:
 1. Under **Wait For**, selecting **Digital Input Transition** would allow your program to wait for a Digital input rising edge or falling edge before playing the next command.
4. Click **Add command > Add Wait**:
 1. Under **Wait For**, selecting **Digital Input** would allow your program to wait for a Digital input to be 0 or 1 before playing the next command.
5. It is also possible to get the state of the Digital Input into a Variable.

The screenshot shows the VENTION MachineLogic interface. The top navigation bar includes 'Configuration', 'Network', 'Manual Control', 'MachineLogic' (selected), 'App Launcher', and a 'STOP' button. On the left, a 'New Application' sidebar shows a tree view with 'Main Sequence' expanded to 'Digital Output', 'Wait Input', 'Wait Input Transition', and 'Set Variable: Device' (selected). The main workspace displays a sequence named 'Main sequence' with four steps:

Step	Command	Parameter 1	Parameter 2	Parameter 3
1	Output	Digital Output	Blue,LED	1
2	Wait For	Digital Input	Relay input #1	1
3	Wait For	Digital Input Transition	Relay input #1	Rising
4	Set Variable	From Device	RELAYSTATE	Relay input #1

At the bottom of the workspace are buttons for 'Upload/Download', 'Add Application', 'Add Sequence', 'Add Command', a green play button, and a grey stop button.

Figure 6: Wait for digital input transition

Using the Digital I/O Module v2 with the Python API

See Python API reference [here](#)